

# RISK ASSESSMENT NOMOGRAPHII

V2.0

Product: **Watts Clever (Australia) Limited—Standby Power**

Assessment ID: **49459**

**Maximum Potential** Severity 4  
 Potential electric shock hazard.


**Probability Of** Possible  
 It is possible the hazard may occur due to incorrect connection of earthing wire.

**Hazard Recognition** Improbable  
 It is improbable that a consumer would recognise the potential for this product to present an electric shock hazard

**Availability** Limited  
 Product was installed directly into homes as part of the Victorian Efficiency Tarnet Scheme

**Initial Risk** Very High (79)

**Final Risk** Significant (59)

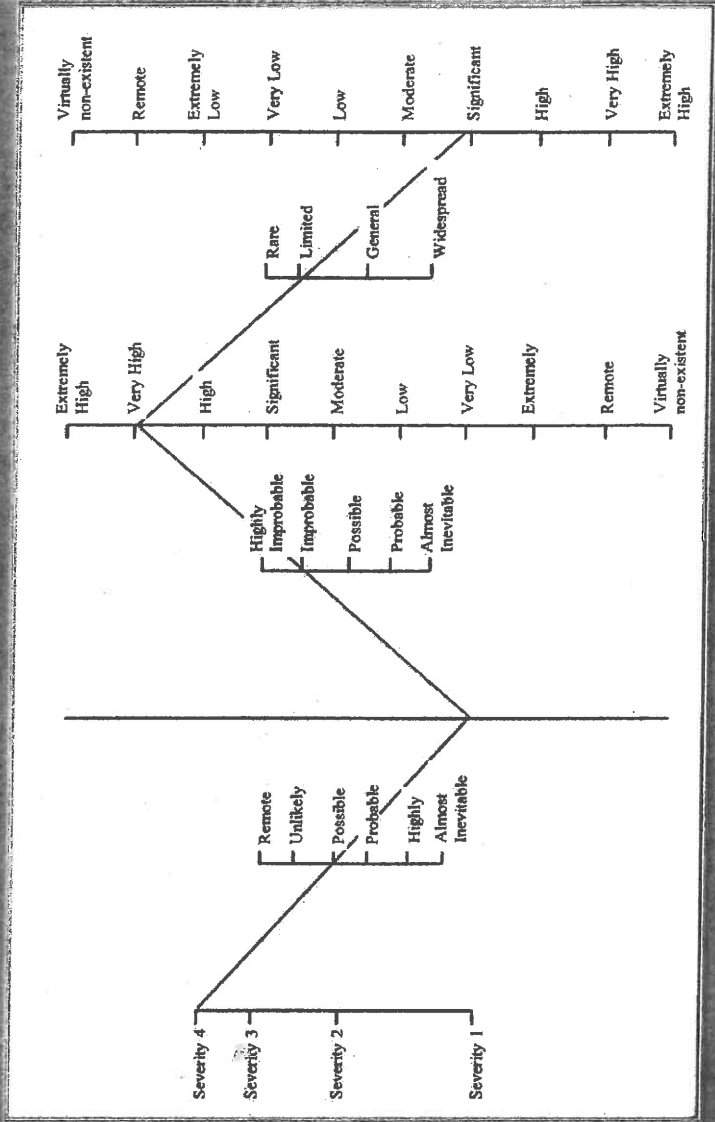

Product Safety Nomograph originally developed by H.G. Benis, 1990. Excel version created by ICE Ergonomics Ltd (UK) for New Zealand Ministry of Consumer Affairs, 1999. Nomograph modified to use RAPEX (EU) injury severity ratings by Australian Competition & Consumer Commission, 2012. © 1999, ICE Ergonomics Ltd. Used with permission of the NZ Ministry of Consumer Affairs.