

RISK ASSESSMENT NOMOGRAPH

v2.0

Product: **Watts Clever (Australia) Limited—Standby Power Controller** Assessment ID: **49459**

Maximum Potential **Severity 4**

Potential electric shock hazard.

Probability Of **Possible**

It is possible the hazard may occur due to incorrect connection of earthing wire.

Hazard Recognition **Improbable**


It is unlikely that consumers will be aware of the defect, prior to its occurrence

Availability **Rare**

Of the 52800 affected products only 6.1% remain unaccounted for

Initial Risk **Very High (79)**

Final Risk **Moderate (49)**

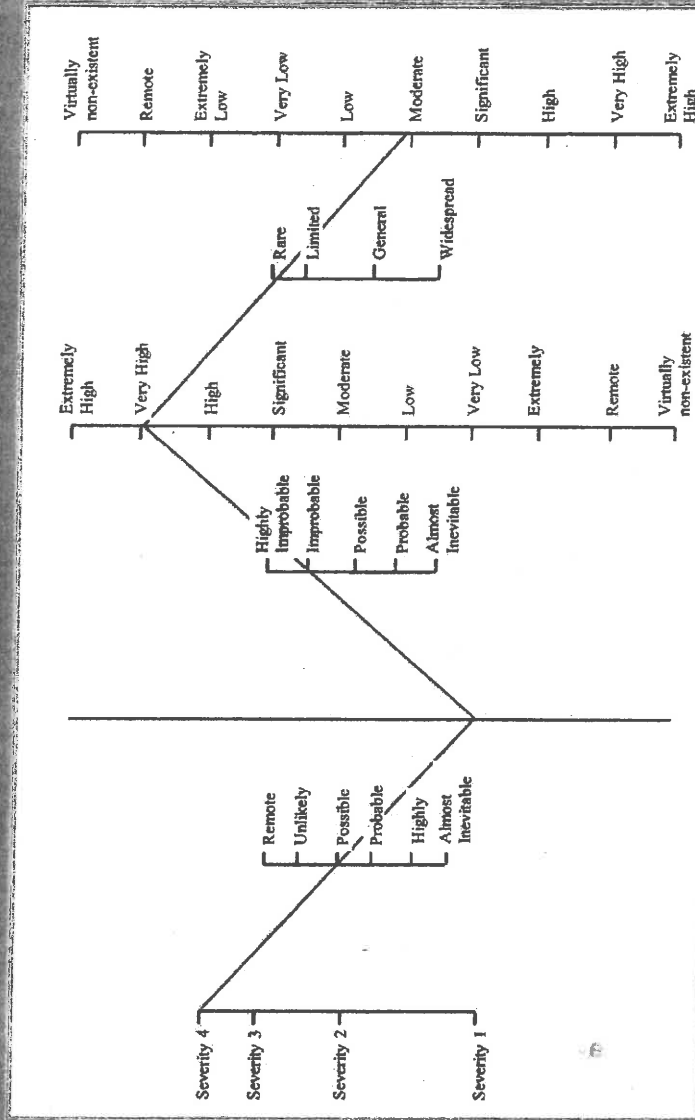

Product Safety Nomograph originally developed by H.G. Benis, 1990.
 Excel version created by ICE Ergonomics Ltd (UK) for New Zealand Ministry of Consumer Affairs, 1999.
 Nomograph modified to use RAPEX (EU) injury severity ratings by Australian Competition & Consumer Commission, 2012.
 © 1999, ICE Ergonomics Ltd. Used with permission of the NZ Ministry of Consumer Affairs.